



# 16 x 42


## PTAC Series

### Packaged Terminal Air Conditioner/Heat Pump

# NOTICE

Use 1 of 2 methods when changing your unit from Celsius (°C) to Fahrenheit (°F):

1. With power to the unit ON, press and hold (+) and (-) buttons together for 3 seconds (unit will beep after 3 seconds) this will alternate the temperature display between (°C ) & (°F). It may be necessary to cycle through all the modes (cool-heat-fan) before the change is effected.
2. Unplug the unit. With power to the unit OFF, turn the S2 dipswitch to DOWN (OFF) position. Turn the power to the unit ON to operate.

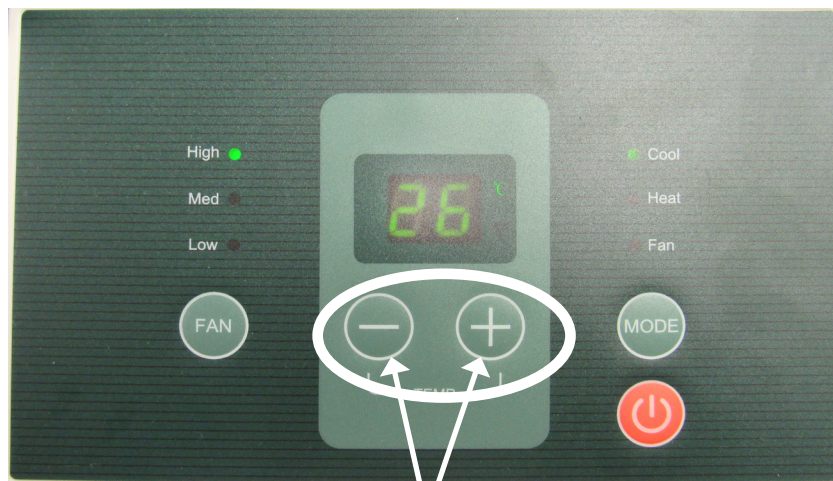

Press and Hold together for 3 seconds

